



# UNIVERSAL SILENCER

P.O. Box 411, Stoughton, Wisconsin 53589  
608-873-4272 Fax 608-873-4298


## STANDARD FH-30-24 AIR INTAKE FILTER

DATE 03-11-09

SHEET 1 OF 1


SCALE NTS

NO.	
REVISION	
DRAWN	
APP'D	

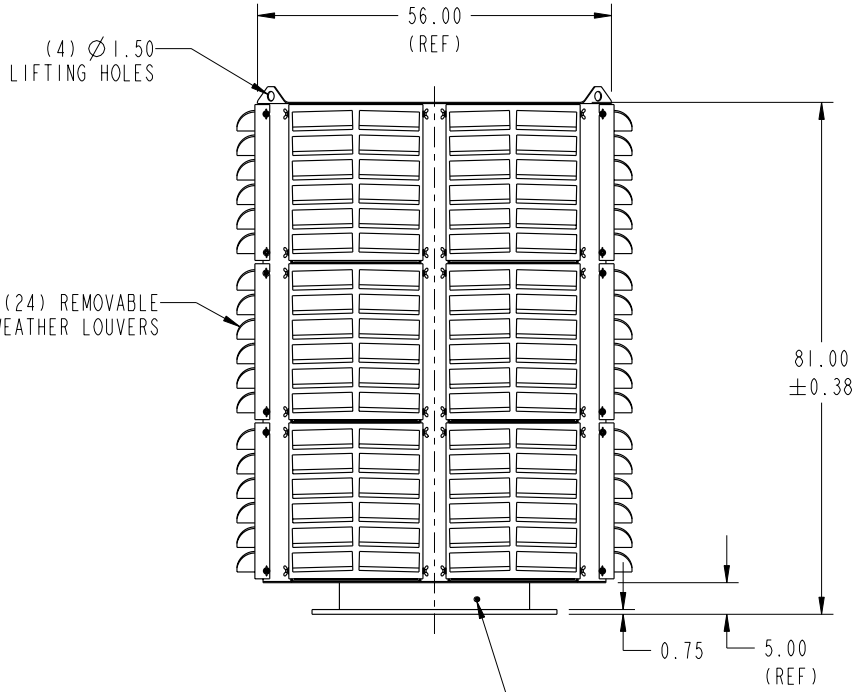

30"-125/150# ANSI  
DRILLED PLATE FLANGE,  
BOLT HOLES STRADDLE C.L.

FILTER ELEMENT  
RETAINER

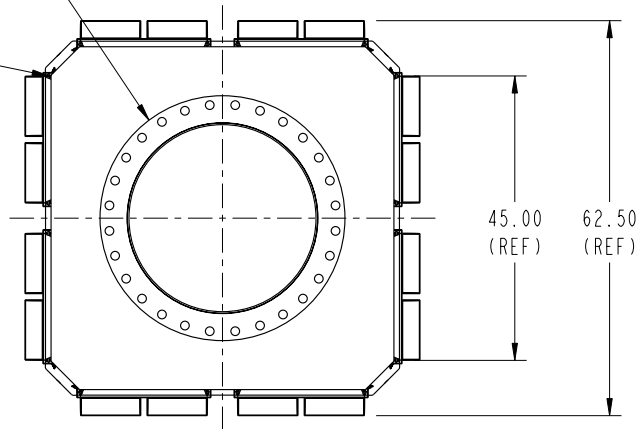

NOTES:

1. WEIGHT SHOWN DOES NOT  
INCLUDE WEIGHT OF FILTER  
ELEMENTS.

2. BLACK HDPE PLASTIC WEATHER  
LOUVERS ARE NOT PAINTED  
(NON-PAINTABLE MATERIAL)



DIMENSIONAL DRAWING NO.

36-530-AAL

FILTER ELEMENTS INCLUDED (APPLIED ONLY TO ORDER FOR WHICH DRAWING IS CERTIFIED)				MOUNTING LEGS YES <input type="checkbox"/> NO <input type="checkbox"/>		DIMENSIONS CERTIFIED FOR:	
FILTER TYPE AND PART NUMBER		SINGLE STAGE	DUAL STAGE PRE-FILTER    FINAL FILTER		P.O. NO:		U.S. S.O. NO:  BY  DATE
					X DIM= _____		
					Y DIM= _____		
					X+Y DIM= _____		
APPROX WT    990 LBS	MATERIAL    STEEL		DRAWN    ALV		DIMENSIONAL DRAWING NO.		REV.
FINISH    88-0116 BLUE ENAMEL		CHECK    JSM 03-16-09		36-530-AAL		0	

0 REV.